
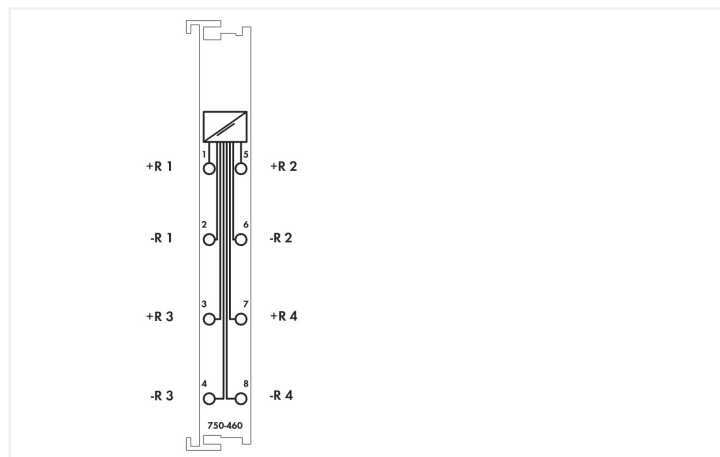



Datový list | Obj. č.: 750-460

4kanálový analogový vstup; Pro odporová čidla Pt100/RTD

<https://www.wago.com/750-460>

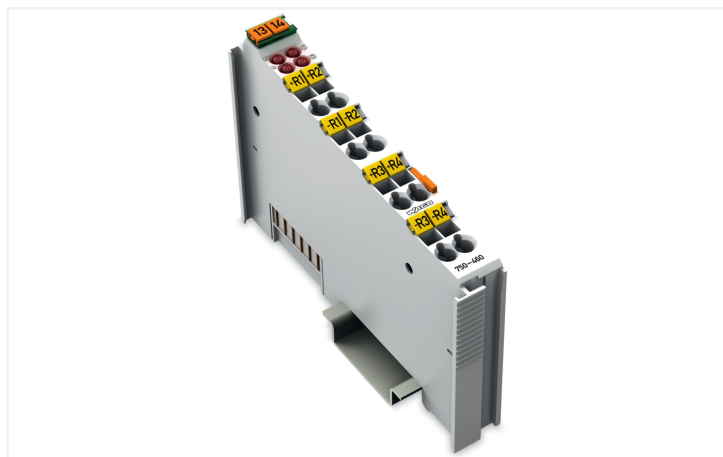

Barva: ■ Světle šedá

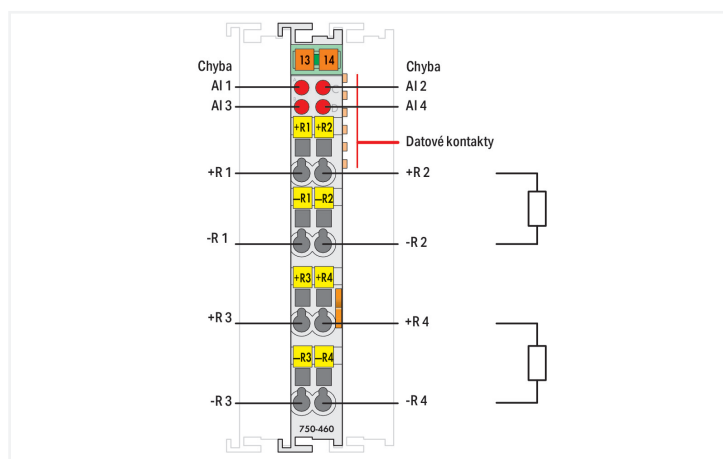

Analogový vstupní modul umožňuje přímo připojit odporová čidla Pt.

Je možné připojit dvou vodičové senzory.

Linearizaci v celém rozsahu teplot zajišťuje I/O modul. Chybu senzoru (zkrat, přerušení kabelu či překročení rozsahu měření) signalizuje červená LED dioda.

Atesty/certifikáty

General approvals



Schválení	Standardní	Název certifikátu
EAC GZO Almaty Standart	TP TC 020/2011	EAC CoC 03083
KC National Radio Research Agency	Article 58-2, Clause 3	MSIP-REM-W43-AIM750
UL Underwriters Laboratories Inc. (ORDINARY LOCATIONS)	UL 508	E175199

Declarations of conformity and manufacturer's declarations

Schválení	Standardní	Název certifikátu
EU-Declaration of Conformity WAGO GmbH & Co. KG	-	-
UK-Declaration of Conformity WAGO GmbH & Co. KG	-	-



Ke stažení			
Environmental Product Compliance			
Compliance Search			
Environmental Product Compliance 750-460			↓

Documentation			
Manual		System Description	
Product Manual 4-channel, resistance sensors	V 1.1.0	pdf	↓
		1272.93 KB	
System Manual Series 750/753			↓
		750/753 Series I/O-System – General Product Information	↓
			953.35 KB
		Overview on WAGO-I/O-SYSTEM 750 approvals	↓
			770.48 KB

Bid Text			
750-460	19.02.2019	xml	↓
		4.30 KB	
750-460	20.10.2017	doc	↓
		28.00 KB	
ausschreiben.de 750-460			↓

CAD/CAE-Data	
CAD data	CAE data
2D/3D Models 750-460	EPLAN Data Portal 750-460
↓	↓
	WSCAD Universe 750-460
	↓
	ZUKEN Portal 750-460
	↓

Device Files			
Device Driver			
WAGO USB Service Kabel Treiber / Serie 750 und 857	6.5.3.0 10.09.2014	zip 4721.96 KB	↓